

CORNELL PUMP COMPANY



REFRIGERATION TROUBLESHOOTING GUIDE



EFFICIENT BY DESIGN



TROUBLESHOOTING

THIS IS DESIGNED TO PROVIDE ASSISTANCE FOR RESOLVING PROBLEMS ASSOCIATED WITH A LIQUID OVERFEED OR TRANSFER PUMP APPLICATION. THE TROUBLE SHOOTING GUIDE IS DIVIDED INTO TWO SECTIONS TO INCLUDE: (1) OPERATIONAL, AND (2) MECHANICAL.

(1) OPERATIONAL

Cavitation, recirculation and vapor entrainment generate the most common operational problems. Unfortunately, the most common operational problems are many times interrelated, misinterpreted or difficult to isolate. As a result, the troubleshooter guidelines employ a hierarchical method of evaluation. The hierarchical method provides the troubleshooter a logical means of evaluation through a process of elimination. Potential operational problems should be evaluated in the following order:

- **CAVITATION**
- **RECIRCULATION**
- **VAPOR ENTRAINMENT**

CAVITATION: When too much flow is demanded of the liquid overfeed or transfer pump cavitation will result. Cavitation is a result of inadequate Net Positive Suction Head Available (NPSHA), and occurs when the Net Positive Suction Head Required (NPSHR) is greater than NPSHA. The typical consequence of cavitation is a noticeable erosion of the pump differential pressure. When the noticeable erosion of the pump discharge pressure occurs, it will be necessary to quickly start closing the pump discharge stop valve and observe the behavior of the pump. If the pump is suffering from cavitation due to an excessive flow rate, the closing of the stop valve will bring about immediate recovery.

RECIRCULATION: Recirculation is a phenomenon common to all centrifugal pumps when operated at a low capacity. Refrigerant pump capacity characteristics are unique to each type of pump within Cornell's refrigeration product group. At one half to one third of the best efficiency point, a secondary flow begins within the impeller whereby the fluid actually reverses direction and exits the eye and/or enters the discharge. This results in turbulence and small vortices. The high velocity at the core of the vortices results in low pressure, often below the vapor pressure of the fluid, and cavitation may ensue.

As previously mentioned, if the pump is suffering from cavitation due to an excessive flow rate, the closing of the discharge stop value

will bring about immediate recovery. However, if the operational problem is due to recirculation, the pump will stumble even more quickly. If the pump begins to stumble even more quickly, the operator should reopen the stop valve and establish a minimum flow requirement via the bypass line. The minimum flow requirement for a given refrigeration pump can be established by the following procedure: (1) fully open the bypass line valve, (2) Close the discharge stop valve, (3) Slowly close the bypass line valve until the pump discharge pressure starts to become unstable as indicated by "bouncing" of the pressure gauge needle, and (4) Open the bypass line valve until the gauge stabilizes.

TROUBLESHOOTING

VAPOR ENTRAINMENT: The phrase “vapor entrainment” implies that the vapor is carried into the pump from an external source. This is distinct from cavitation where the vapor is actually generated within the pump. Vapor entrainment is traditionally misinterpreted as cavitation. However, similar to cavitation, vapor entrainment may actually result in an auditory signal or diminish the amp draw by the motor. Moreover, vapor entrainment typically restricts the flow of the pumpage through the eye of the impeller to the point that coils may not be adequately fed.

When vapor entrainment restricts the flow of the pumpage through the eye of the impeller, inclusion of a bypass line will not resolve this operational problem. However, if the pump is connected to an adequately sized and adjusted bypass line and/or there are system loads on line then recirculation can likely be ruled out. Vessel and piping design are always involved no matter what is deemed to be the greatest contributing factor.

Horizontal vessels always have less submergence available to separate the surface boiling from the mouth of the drop leg. Simple vortexing is not often a problem anymore as most vessel manufacturers have learned to include crossed

plate vortex eliminators or similar devices in the mouth of the drop leg. However, vapor entrainment due simply to the proximity of the boiling layer to the mouth will still occur if the submergence is less than about 18 inches. If any pressure drop in the vessel is quicker than 1 psi/min, boiling will occur about 3 feet below the liquid surface, and then obviously 18 inches of submergence will not prevent vapor from entering the drop leg. In a vertical vessel it would be unusual if there were not more than 3 feet of submergence. However, if the drop leg is properly sized, then the full liquid height from the operating level to the pump level can be used to protect against vapor entrainment rather than just the submergence above the mouth of the drop leg.

Vapor entrainment problems are also directly related to the rate of pressure drop during any transient in the vessel. This leads to the discussion of false loads. The key to avoiding vapor entrainment in a vessel is to keep the rate of pressure drop as low as possible during any pressure reduction. Pressure reductions occur when a system is started up from ambient-temperature and pressure must be brought down to their design values before they stabilize. Pressure reductions also occur when

something upsets the system, such as increased refrigeration demand caused by a new batch of warm product being brought to a freezer or increased shipping and receiving activity which allows more warm air into the refrigerated space.

Another source of false load occurs as a result of hot gas defrosting practices. During hot gas defrost of an evaporator the liquid supply solenoid to that evaporator closes, the defrost regulator on the evaporator outlet closes, and a hot gas supply solenoid opens. Hot gas from the high side enters the evaporator and warms the coils. After a while the pressure inside the evaporator builds high enough that the defrost regulator opens, and now hot gas starts blowing down the wet return line to the LPR.

In addition to the aforementioned recommendations, there are a variety of piping considerations designed to minimize the effects of vapor entrainment. In particular, the bypass line, pump leg line velocities, suction vent line, and volute line.

TROUBLESHOOTING

(2) MECHANICAL

An eventual consequence of operational problems can be mechanical failure. The following fault matrix highlights the most common mechanical failures and associated modes of failure:

MECHANICAL PROBLEM	REMARK	CORRECTIVE ACTION
Loss of prime at start-up	Volute vent line feeds to another line instead of directly into the receiver	Volute vent piping should be directly into the separator above the maximum liquid level
	Vent line closed	Open volute vent line
	Pump started before completely filled with liquid or before cooled down	Follow the "start-up instructions" carefully and allow ample time for system to balance and pump to cool down
Loss of prime during operation	Pump started with discharge valve fully open	Throttle discharge valve at start up to almost shut-off and open it very gradually
	Cavitation	Cavitation due to an excessive flow rate, the closing of the stop valve will bring about immediate recovery-adjust the hand expansion valves as necessary to bring the flowrate within NPSHA limitations
	Recirculation	Utilize a bypass line to ensure minimum flow requirement
Motor overloading new installation	Vapor entrainment	Evaluate false load condition
		Reduce rate of temperature draw down in receiver by the compressors
		Raise liquid level in receiver
Motor overloading existing installation	Incorrect rotation	Ensure proper rotation
	Incorrect pump selection	Review performance conditions and consult factory
	Incorrect hand expansion valve setting	Adjust the hand expansion valves as necessary to bring the flowrate within NPSHA limitations
Motor overloading existing installation	Oil indigestion from system	Check amperage and voltage, compare with normal power, oil ingestion will increase power requirement and potential to overload the motor

TROUBLESHOOTING

FOR TECHNICAL SUPPORT FOR LIQUID OVERFEED OR TRANSFER PUMP APPLICATIONS, CONTACT THE REFRIGERATION MARKET GROUP AT PH 503.653.0330, FX 503.653.0338 OR CORNELL'S WEB SITE.

MECHANICAL PROBLEM

External seal (characteristics) leak

REMARK

Failure of outboard mechanical seal assembly

CORRECTIVE ACTION

Mechanical seal replacement required with a Cornell mechanical seal replacement kit

Internal seal leak

Failure of inboard mechanical seal assembly

Replace mechanical seal with a Cornell mechanical seal replacement kit

Characterized by high oil consumption but no visible oil leak

Please note: a seal replacement video is available from Cornell Pump Company and at <http://www.cornellpump.com/support/videos.html>

VAPOR ENTRAINMENT - IN DEPTH

Centrifugal pumps for refrigerant recirculation in liquid overfeed systems are very simple devices, as they employ essentially one moving part. Consequently, problems from the pump's perspective (to anthropomorphize a piece of iron) are also simple. When too much flow is demanded of the pump by the system, cavitation will result. Conversely, insufficient flow through the pump may result in heating and boiling of the pumpage or in cavitation due to "recirculation". These are indicative of an improperly sized pump or an improperly adjusted system. A third simple characteristic of centrifugal pumps is that while they are very efficient liquid movers, they do a very poor job of pumping gasses or multi-phase fluids. Vapor entrained in the liquid stream to the pump suction in large enough volume does not simply pass through the pump. A popular analogy is that of

transporting helium filled balloons in your car. When you accelerate away from a stop, the balloons actually move forward toward the windshield. This is because the air surrounding the balloons is heavier than the helium; when you accelerate, the heavier air is forced toward the back of the car and displaces the lighter helium forward. In a similar fashion, the heavier liquid component of the pumpage is thrown outward by the centripetal action of the rotating impeller, and the lighter vapor is "centrifuged" toward the center of rotation. This creates a vapor blockage at the eye of the impeller which reduces or prevents the passage of the liquid- the pump is "vapor bound." The phrase "vapor entrainment" implies that the vapor is carried into the pump from an external source. This is as distinct from cavitation where the vapor is actually generated within the pump. However, where

the vapor content is not sufficient to stop the flow through the pump, it may actually result in noise which sounds exactly like cavitation. Nevertheless, it is not directly related to or affected by the pump's Net Positive Suction Head Required (NPSHR) or the system's Net Positive Suction Head Available (NPSHA). How do you tell the difference? Diagnosis begins with an evaluation of how likely vapor is to be the problem.

A horizontal vessel is far more likely to contribute to vapor problems than a vertical. The distance between the operating level and outlet of the vessel (the mouth of the drop leg) is always smaller with a horizontal vessel. This lack of submergence means that the pump suction line is closer to the vapor phase in the vessel so that vortexing is more likely. More importantly, the pump suction is closer to any

VAPOR ENTRAINMENT CONT.

surface boiling that occurs, and this increases the likelihood that vapor will be drawn into the suction line.

Where process loads predominate vs. cold storage loads, there are going to be more load variations and resulting pressure transients in the vessel. The “instabilities” will result in more boiling within the vessel and simply increase the likelihood that the pump will ingest vapor.

The preceding two system design/application characteristics individually or in unison make vapor entrainment a very likely cause of problems, and there are simple methods available to verify this. At the onset of a vapor entrainment event, the pump discharge pressure will begin to fall off very noticeably. When this begins to occur, it will be necessary to quickly start closing the pump discharge stop valve and observe the behavior of the pump. If the pump is suffering from cavitation due to too high a flow rate, the closing down of the stop valve will bring about almost immediate recovery. However, if the problem is due to vapor entrainment, the pump will stumble even more quickly and will likely lose prime. This is because the liquid velocities inside the pump impeller become inadequate to sweep vapor through, and more of the vapor becomes “stuck” in the impeller eye. Pump performance that is faltering due to low flow recirculation will also worsen as the stop valve is closed down. However, if the pump is connected to an adequately sized and adjusted bypass line and/or there are system loads on line (not all liquid solenoids closed), then recirculation is so unlikely as to be relegated to the end of the check list. This simple test using the discharge stop valve will most likely reveal whether or not there is a vapor

problem but not what its cause is. Unfortunately, the causes are numerous and often interrelated.

Vessel and piping design is always involved no matter what is deemed to be the greatest contributing factor. As previously mentioned, horizontal vessels always have less submergence available to separate the surface boiling from the mouth of the drop leg. Simple vortexing is not often a problem anymore as most vessel manufacturers have learned to include crossed plate vortex eliminators or similar devices in the mouth of the drop leg. However, vapor entrainment due simply to the proximity of the boiling layer to the mouth will still occur if the submergence is less than about 18 inches. If any pressure drop in the vessel is quicker than about 1 psi/min, boiling will occur about 3 feet below the liquid surface, and then obviously 18 inches of submergence will not prevent vapor from entering the drop leg. In a vertical vessel it would be unusual if there were not more than 3 feet of submergence. However, if the drop leg is properly sized, then the full liquid height from the operating level to the pump level can be used to protect against vapor entrainment rather than just the submergence above the mouth of the drop leg. If the drop leg is sized for a liquid velocity of about 25 ft./min., the bubbles will rise at a rate faster than the downward liquid velocity. In many cases a drop leg of larger diameter than the pump suction size is not used; rather, the pump suction pipe is simply connected directly to the vessel, and the horizontal to vertical transition is made with a long radius elbow. In such designs, the likelihood of vapor entrainment is greatly increased by the higher velocity in the smaller diameter line. Often the drop or pump leg is made

reentrant to the vessel projecting through the vessel wall rather than flush with it. This is done to prevent oil entrance to the pump. However, if the projection is made too long some of the submergence is lost.

Along with the vessel design, all but a few vapor entrainment problems are also directly related to the rate of pressure drop during any transient in the vessel. This leads to the discussion of false loads. The key to avoiding vapor entrainment in a vessel is to keep the rate of pressure drop as low as possible during any pressure reduction. Pressure reductions occur when a system is started up from ambient-temperature and pressure must be brought down to their design values before they stabilize. Pressure reductions also occur when something upsets the system, such as an increased refrigeration demand caused by a new batch of warm product being brought to a freezer or increased shipping and receiving activity which allows more warm air into the refrigerated space. A false load is not directly related to an actual increase in refrigeration required but is due to the way the system functions. For example, when the liquid level in the LPR drops and the float switch causes the makeup solenoid to open, high pressure, high temperature refrigerant flashes into the LPR. This make-up refrigerant is as much as 30% vapor by weight, and this vapor is simply flash gas, it is not the result of any refrigeration load. In order to maintain the pressure in the LPR at saturation pressure the compressor(s) will load up to a higher percentage of capacity in order to remove the excess gas from the receiver. When the LPR liquid level is restored the float switch will close the solenoid, and the flash gas supply will be instantly removed.

TROUBLESHOOTING


VAPOR ENTRAINMENT CONT.

However, the compressor cannot unload instantly, so it will continue to operate for a time, fully loaded but drawing on a reduced gas supply. As a result the LPR pressure will drop until the compressor can unload. If this pressure drop is greater than about 1 psi/minute the liquid in the LPR will boil about 3 feet below the liquid surface, the pump will draw in the vapor and will lose prime until the vapor blockage “burps” through.

Another source of false load occurs as a result of hot gas defrosting practices. During hot gas defrost of an evaporator the liquid supply solenoid to that evaporator closes, the defrost regulator on the evaporator outlet closes, and a hot gas supply solenoid opens. Hot gas from the high side enters the evaporator and warms the coils. After a while the pressure inside the evaporator builds high enough that the defrost regulator opens, and now hot gas starts blowing down the wet return line to the LPR. This, again, is a false load, and the compressors respond just as with the make-up cycle. Sometimes there are ways to control false loads more closely, and sometimes compressors can be loaded more slowly, but false loading is a common source of pump grief. This grief is more from the standpoint of the operator than from the pump, because our pump will run vapor locked without a problem. If the vapor lock lasts too long, though, then the plant begins to have trouble maintaining temperature.

VOLUTE VENT LINE

During initial flooding of a liquid overfeed pump, refrigerant will absorb heat from the pump casing and boil off. The gas will collect at the high point of the volute and must be vented off before startup. In addition, the volute vent line provides a discharge avenue for the refrigerant during the pump draining. The volute vent line should not be tied into the bypass or suction vent line.

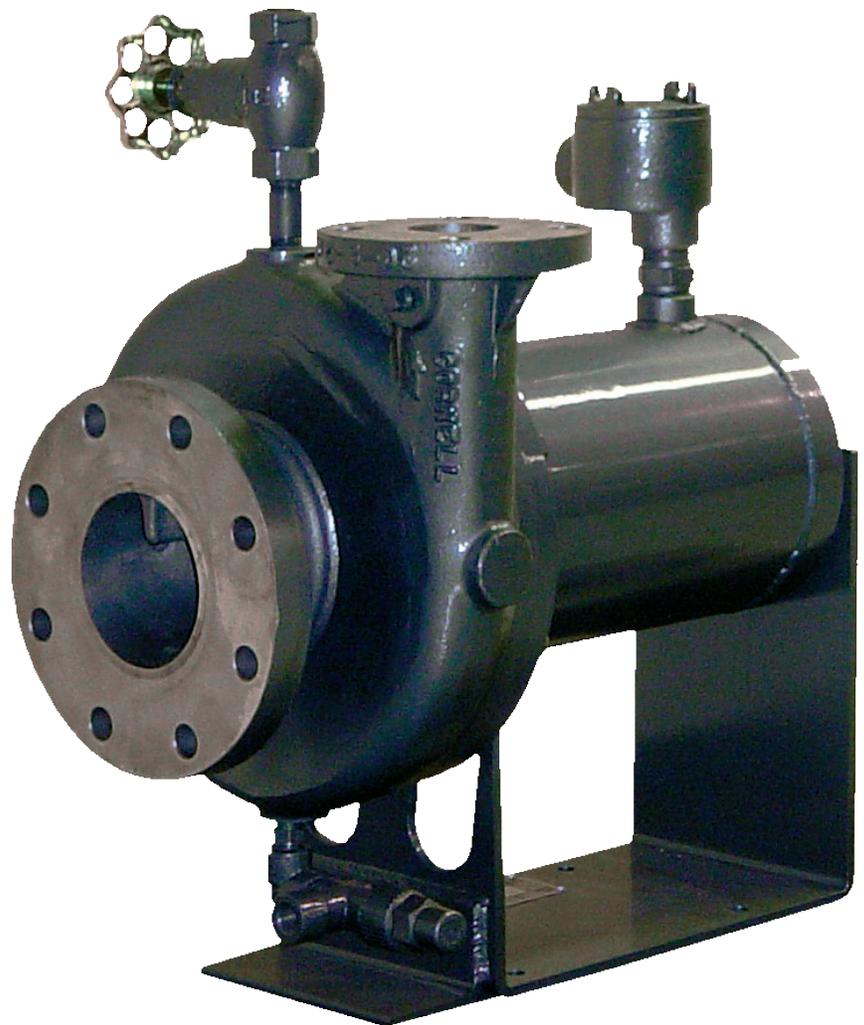

MARKET AND PRODUCT LINE



AGRICULTURAL



FOOD PROCESS




INDUSTRIAL



MINE DEWATERING



MUNICIPAL




REFRIGERATION



OIL & GAS



CHOPPER



CUTTER



EDGE™



HYDRAULIC SUBS



HYDRO TURBINE



IMMERSIBLE



MANURE



MP SERIES



MX SERIES




MX MINING



REDI-PRIME®



STX SERIES



SLURRY



SUBMERSIBLE



WATER TRANSFER

Cycloseal®, and Redi-Prime® are Registered Trademarks of Cornell Pump Company.

Cornell pumps and products are the subject of one or more of the following U.S. and Foreign patents: 3,207,485; 3,282,226; 3,295,456; 3,301,191; 3,630,637; 3,663,117; 3,743,437; 4,335,886; 4,523,900; 5,489,187; 5,591,001; 6,074,554; 6,036,434; 6,079,958; 6,309,169; 2,320,742; 96/8140; 319,837; 918,534; 1,224,969; 2,232,735; 701,979 and are the subject of pending U.S. and Foreign Patent Applications.

NEW ZEALAND (HEAD QUARTER)
 No. 7 Mount Albert Road, Royal Oak
 Auckland 1023, New Zealand
 Tel: +64-9-950 8714
 Email: sales@cornellpumpsupply.com

